(.250 MG)

(.375 MG)

(100 MGD)
Combined

Spring Not In Use

Chlorine Contact Tank
(.050 MGD)

Denied Access

To Main Spring and Dennings Well

See Insert




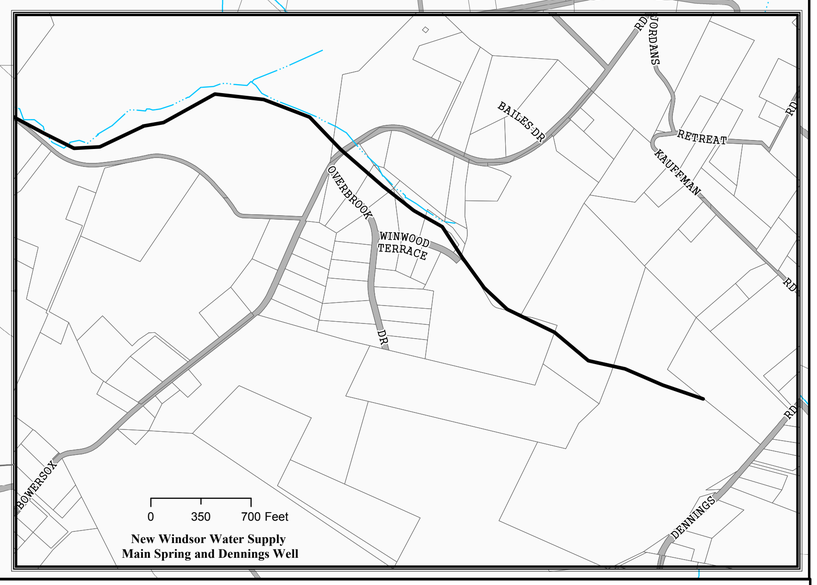


New Windsor Water Supply
Main Spring and Dennings Well

# New Windsor Water Service Area

## Carroll County, Maryland

2014 Water & Sewer Master Plan

600 300 0 600 Feet

MAP W-7

### Existing and Planned Service Areas

- S - 1 Existing/Final Planning
- S - 3 Priority (0-6 yr)
- S - 5 Future (7-10 yr)
- S - 6 Long Range (10+ yr)
- S - 7 No Planned Service

### Existing and Planned Community Facilites

| | Existing | Priority | Future | Not in use |
|---|---|---|---|---|
| Transmission or Feeder Main | | | | |
| Treatment Plant (Capacity - MGD) | WTP | WTP | WTP | |
| Pumping Station (Capacity - MGD) | | | | |
| Storage Tank (Capacity - MG) | W | P/W | F/W | |
| Well (Capacity - GPM) | W/EX | W/P | W/F | |
| Spring | S | | | |
| Reservoir (Capacity - MGD) | | | | |

Corporate Limit

This data is prepared by Carroll County for internal use and is made availible because it is public information. Carroll County, its agencies or employees, do not warrant its accuracy or suitability for any purpose. The reader should contact appropriate regulating agencies to determine accuracy or suitability of the data for a particular use. This map is for planning purposes only.

Prepared by the Department of Land Use, Planning & Development. 08/11/2015 (mr)

| REV. NO. | DATE | DESCRIPTION | REV. NO. | DATE | DESCRIPTION |
|---|---|---|---|---|---|
| | | | 5. | 10/26/04 | Spring 2004 Amendments |
| | | | 4. | 12/14/01 | UPDATE |
| | | | 3. | 5/18/1999 | UPDATE |
| 7. | 03/03/2009 | Fall 2008 Amendments | 2 | 9/18/1998 | 1998 AMENDMENT TO 1997 PLAN |
| 6. | 09/10/07 | Effective Date: September 10, 2007 | 1 | 3/18/1997 | 1997 AMENDMENT TO 1994 PLAN |